

size of equipment for the production of electrical energy based on such information and control processes increase.

#### References

1. Siddikov I. Kh., Sattarov Kh. A., Khujamatov Kh. E., Dehkhonov O. R. Modelling of the Processes in Magnetic Circuits of Electromagnetic Transducers: International Conf. on ISISCT – 2016, Tashkent, Uzbekistan, 2–4 November, 2016.
2. Nazarov F. D., Khakimov M. Kh. Energy management and energy audit in energy sector of Republic Uzbekistan. Control of power system – 04 : Thesis's VI – int.conf. June 16–18. 2004. – Slovak Rep., High Tatras, Strbske Pleso, 2004. P. 230–235.
3. Siddikov I. Kh. The Electromagnetic Transducers of Asymmetry of Three-phases Electrical Currents to Voltage. Universal Journal of Electrical and Electronic Engineering. Horizon Research Publishing Corporation USA. 2015. Vol. 3. № 5. P. 146–148.

УДК 621.314

## THE PRINCIPLE OF DESIGN OF ELECTROMAGNETIC TRANSDUCERS OF ONE, THREE AND MULTI-PHASES CURRENT OF ELECTRICAL NETS TO SECONDARY VOLTAGE

*I. Kh. Siddikov, Kh. E. Khujamatov*

*Tashkent University of Information Technologies (Uzbekistan)*

Цель данной работы разработка ЭМС с повышенной надежностью и улучшенными эксплуатационными возможностями. Решена задача о том, что в ЭМКТ к напряжению (ЭМКВТ) магнитная цепь выполняется с одним, тремя и многофазными углублениями, расположенными вдоль оси, которая двумя внешними пересечениями в одном направлении оси, а средой - по другую сторону оси-ИС.

**Ключевые слова:** многофазные проводники, электрическая сеть, энергосистемы, участки магнитного сопротивления

The objective of this work is developed with enhanced reliability and improved operational capabilities of EMCT. The problem is solved that in EMCT to voltage (EMCVT) the magnetic circuit is performed with one, three and multi - phases recesses located along the axis, which two outer recesses in one direction of the axis, and the medium - on the other side of axis.

**Keywords:** multi - phase conductors, electric network, power systems, magnetic resistance portions

The monitoring and control of processes of production, transmission, distribution and consumption of electric energy is very importance's performance means of transformation of current which leads to significant economic losses. Developing an integrated approach, providing high accuracy and efficiency of the combined control sources of electricity, increase operational capabilities, simplifying the design, reducing weight and size indicators, improving manufacturing techniques, ensuring endless measuring processes, a current conversion through the use of modern transducers are ongoing challenges electricity consumption management. The electromagnetic current transformers (EMCT) at the same time

as the main elements of information-measuring and control systems, almost fully determine the technical and economic performance of power production, transmission, distribution and consumption systems [1,2].

The air gap, which there are located U - bracket of magnetic material, which are located inside the insulating plate with measure windings [3]. Limitations uses of EMCVT are: low accuracy during transformation of primary quantities to the secondary on the bases of saturation effect a closed magnetic system, complexity of their installation in different areas of electric nets and no nominated weight and size of construction devices and elements, impossibility of simultaneous control of magnitude and the phase currents of one, three and multi - phases net, which reduces the reliability and limited scope.

The aim of this research is improve of metrological characteristics of construction and parameters of transducers of primary one, three and multi - phases currents of electrical nets and expand the functionality of the design, when conversion of electric quantities to magnetic field. In Fig.1a, b shown constrictions of developing EMCVT with improved metrological and operational characteristics [4]. In fig. 1 shown EMCTV which contain a magnetic core 1, with one, three and multi - phases grooves along the axis, from them two outer recesses in one direction of the axis, and the medium on the other side of the axis, here air gap located the primary winding, the conductors A, B and C - phase of electrical net and U - brackets 2, 3 and 4 of magnetic material, which are measure windings 5, 6 and 7 on the insulating plates 8, 9 and 10. EMCVT, shown in fig.1 works as follows: when the current flows in A, B and C in primary windings of the one, three and multi - phases conductors of the electrical net, in the magnetic core 1 appear a magnetic fluxes  $F_1$ ,  $F_2$  and  $F_3$ , which in the gap between the ends of the cross turns flat measure windings 2, 3 and 4 where in:

$$F_1 = (I_A \cdot W_A) / R_{\mu 1}, \quad (1)$$

$$F_2 = (I_B \cdot W_B) / R_{\mu 2}, \quad (2)$$

$$F_3 = (I_C \cdot W_C) / R_{\mu 3}, \quad (3)$$

where:  $I_A$ ,  $I_B$  and  $I_C$  - the primary currents flowing through the primary winding of the conductors A, B and C -phase of electrical net;  $W_A$ ,  $W_B$ ,  $W_C$  – number of turns of the primary winding of the conductors A, B and C - phase electrical net (here  $W_A = W_B = W_C = 1$  - i.e., each primary winding is made in the form of one loop and located in the recess of the magnetic cores);  $R_{\mu 1} = R_{\mu 2} = R_{\mu 3}$  – accordingly, the total magnetic resistance of sectors of the magnetic core and air gap of paths of magnetic fluxes  $F_1$ ,  $F_2$  and  $F_3$ .

In the developed of processes of design of EMCTV, in magnetic resistance separated portions of circuit transformation  $R_{\mu}$  depends on the geometric dimensions of the magnetic core, a U – shaped bracket, air gap and allow us to determine the range of the converted value of the primary currents  $I_A$ ,  $I_B$  and  $I_C$ .

$$R_{\mu} = \rho l / S \quad (4)$$

where:  $\rho$  – specific resistance of the magnetic sections of the magnetic core,  $\delta$  – the value of air gap magnetic circuit, i.e. the length of the air (non- magnetic) areas in the path of the magnetic flux  $F$ ,  $S$  - Cross section areas in the path of the magnetic flux.

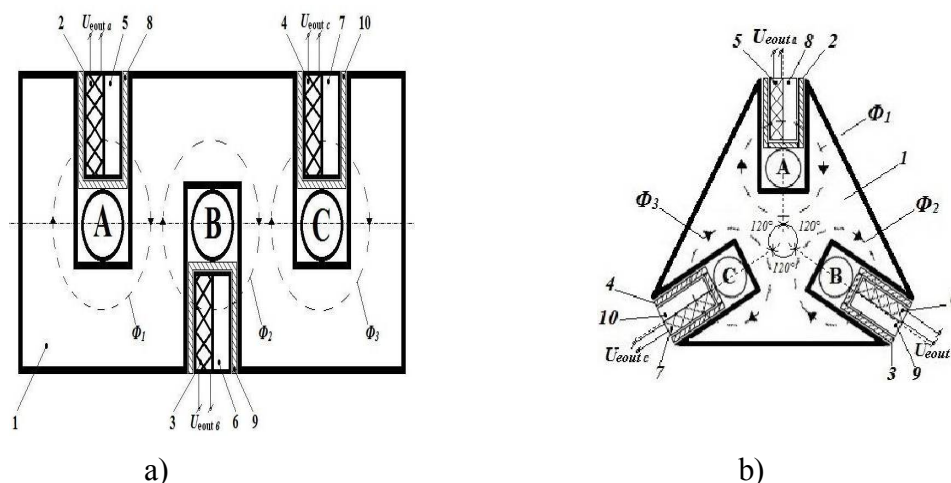


Fig.1. The constructions of EMCVT

*a* – with horizontally magnetic systems, *b* – with triangular magnetic systems.

The voltage at the output of each measuring coil  $U_{eout1}$ ,  $U_{eout2}$  and  $U_{eout3}$  determined according to interference of the magnetic fluxes  $F_1$ ,  $F_2$  and  $F_3$  in magnetic core (Fig.1) and magnitude flux of air gap  $\delta$ :

$$U_{eouta} = 4,44 f \cdot W_1 F_1, \quad (5)$$

$$U_{eoutb} = 4,44 f \cdot W_2 F_2, \quad (6)$$

$$U_{eoutc} = 4,44 f \cdot W_3 F_3, \quad (7)$$

where:  $W_1 = W_2 = W_3$  is the number of turns of a flat measure windings (measure winding is carried out with the same number as  $W$ ),  $f$  – frequency of the supply mains.

The magnetic fluxes  $F_1$ ,  $F_2$  and  $F_3$  created by the primary currents  $I_A$ ,  $I_B$  and  $I_C$  of one, three and multi - phase conductors of an electric network and having the ability to change their values depending on the magnitude of air gap  $\delta$  allow signal of currents in output voltage.

In Fig.1,b showed a perspective view of the structure EMCVT power systems. Power system devices includes a magnetic circuit 1, triangular, in shape with a U – notches at the tops, inside which the clamps 2, 3 and 4 of magnetic material, and the recess is designed similarly and rotated between a  $120^\circ$ , and within each recess is a source of magnetic flux, the primary winding is A, b and C of the primary conductor one, three and multi – phases electrical net and measuring coil 5, 6 and 7 on insulating plates 8, 9 and 10 [5].

When current flows in *A*, *B* and *C* - in the primary windings of the one, three and multi - phases conductors of the electrical network, in the magnetic core 1 of the electromagnetic transducer one, three and multi - phases current appears uniform symmetrical magnetic fluxes  $F_1$ ,  $F_2$  and  $F_3$ , which are between the ends of the crossed coils, the measuring coils 5, 6 and 7, where:

$$\Phi_1 = (I_A \cdot W_A) / R_{\mu 1}, \quad (8)$$

$$\Phi_2 = (I_B \cdot W_B) / R_{\mu 2}, \quad (9)$$

$$\Phi_3 = (I_C \cdot W_C) / R_{\mu 3}, \quad (10)$$

where:  $I_A, I_B, I_C$  - the primary currents flowing through primary winding of the conductors  $A, B$  and  $C$  one, three and multi - phase electrical nets;

$W_A, W_B, W_C$  – number of turns of primary winding of conductors  $A, B$  and  $C$  one, three and multi - phases electric network (here  $W_A = W_B = W_C = 1$ - i.e., each primary winding is made in form of one loop and located in recess of magnetic cores);

$R_{\mu 1} = R_{\mu 2} = R_{\mu 3}$  – accordingly, the total magnetic resistance of sectors of the magnetic core and the air gap in the path of the magnetic fluxes  $\Phi_1, \Phi_2$  and  $\Phi_3$ .

In power system telecommunications devices the magnetic resistance portions of circuit transformation  $R_{\mu}$  depends on the geometry of the magnetic circuit, notches, shaped bracket, the air gap and allow us to determine the range of the converted value of the primary currents  $I_A, I_B, I_C$ .

$$R_{\mu} = \rho l / S \quad (11)$$

where:  $\rho$  – specific resistance of the magnetic sections of the magnetic core,  $\delta$  – the value of air gap of magnetic circuit.  $S$  - cross section of areas in the path of magnetic flux.

The voltage at the output from each of the measure coil  $U_{eout1}, U_{eout2}$  and  $U_{eout3}$  EMCVT of power system of telecommunications devices are based on interference of the magnetic fluxes  $F_1, F_2$  and  $F_3$  in the magnetic core (Fig.1) and the magnitude of air gap  $\delta$ :

$$U_{\text{вблхх}} = 4,44 f \cdot W_1 F_1, \quad (12)$$

$$U_{\text{вблхб}} = 4,44 f \cdot W_2 F_2, \quad (13)$$

$$U_{\text{вблхс}} = 4,44 f \cdot W_3 F_3, \quad (14)$$

where:  $W_1 = W_2 = W_3$  is the number of turns of the measuring coils (measuring coil are performed with the same number of turns  $W$ ),  $f$  – frequency of the supply mains.

The symmetrical magnetic fluxes  $F_1, F_2$  and  $F_3$ , created by the primary currents  $I_A, I_B$  and  $I_C$  of the one, three and multi - phases conductors of the electrical net in dependence on the geometrical sizes of staples of magnetic material, number of turns of the measuring coils and air gaps  $\delta$ , allow to obtain a signal with high accuracy on the multi - phase currents of electrical net of power supply system in the form of output voltage.

Due to implementation of the magnetic core with cut-outs located along the axis, of which the two outer recesses in one direction of the axis, and the medium on the other side of the axis, the air gap, in which there are P - brackets of magnetic material, which are located inside the insulating plate with flat measuring windings, allows to efficiently convert the signal and a magnitude

and phase of the multi phase currents of the electrical network, changing the limit of large range according to the electrical load, there is an opportunity to convert large currents in the range of primary currents due to the improved shape of the magnetic conversion circuit, a spatial arrangement of the air gaps, to simplify the design and geometric dimensions of magnetic circuits of electromagnet transducer and due to the implementation of the magnetic shape with similar notches on the vertices and rotated between a  $120^0$ , location inside the recesses of primary conductors of a three-phase electrical network and measurement of the coil insulating plate, placed in a U – shaped bracket of non-magnetic material, allows to effectively capture the measurement coil and to convert the signal as magnitude and phase, varying in the limit of large range according to the electrical load and the cross section of the conductor.

There is possibility of accurately transform primary currents in a large range of variation due to the use of U - shaped brackets for fixed installation of measuring coils, improving the shape of the magnetic conversion circuit, a spatial symmetric with the air gaps, allowing the creation of the magnetic system of magnetic symmetrical flow and simplify the design EMCVT.

#### References

1. Siddikov I. Kh. Automatization of the power station and power systems. – TSTU, Uzbekistan, Tashkent, 2007. – 35 p.
2. Siddikov I. Kh., Abdulaev A. Kh., Bobojanov M. K. Perfection and development of sensor controls and measuring transducers on a basis of information-energetics model // WCIS. 2002. Collection of the works. II – World conf. 4–5 June, 2002 y. b-Quadrat Verlag, Azerbaijan State Oil Academy, Azerbaijan, Baku, 2002. P. 310–315.
3. Siddikov I. Kh., Khakimov M. Kh., Anarbaev M., Bedritskiy I. M., Research of the electromagnetic transducers of the primary current to secondary voltage // Science and Education. Materials of the II International Research and practice conference. Vol. I. Publishing office of «Vela Verlag Waldkraiburg», Munich, Germany, December, 18–19. 2012. – P. 222–225.
4. Azimov R. K., Siddikov I. Kh., Khakimov M. Kh., Mukhammadiev S. M., Nazarov F. D., Xonnazarov B. V., Mamatkulov A. N. Patent RUz. UZ IAP. № 04562. The Transducer of currant to voltage, Official Bulletin. №8. 2012.
5. Allaev K. R., Azimov R. K., Siddikov I. Lh and ets.. Patent RUz. UZ IAP 04907. The Transducer of currant to voltage, Official Bulletin № 6. 2014.

УДК [378.147.88: 378.662]

### РЕШЕНИЕ ЗАДАЧ ПО ФИЗИКЕ С ИСПОЛЬЗОВАНИЕМ АЛГОРИТМИЧЕСКИХ ПРЕДПИСАНИЙ

*В. П. Быкова*

*Астраханский государственный архитектурно-строительный университет  
(Россия)*

Новый метод решения заданий по физике, основанный на использовании универсальных алгоритмических предписаний, даст будущему молодому специалисту получить должные навыки применения своих знаний и умений для проектирования научных